

**Floor towards attic (uninhabitable) - ddrtxn04a-00**

floor towards attic (uninhabitable), timber frame construction, not suspended, dry, other surface



**Performance rating**

**Fire protection performance** REI 30  
 maximum span = 5 m; maximum load  $E_{d,fi} = 3,66 \text{ kN/m}^2$   
 Classified by IBS

**Thermal performance** U Diffusion 0.18  $\text{W}/(\text{m}^2\text{K})$   
 suitable  
 Calculated by HFA

**Acoustic performance**  $R_w (C;C_{tr})$  43(-2;-6) dB  
 $L_{n,w} (C_i)$

**Mass per unit area** m 66.40  $\text{kg}/\text{m}^2$   
 Calculation based on gypsum plaster board type DF

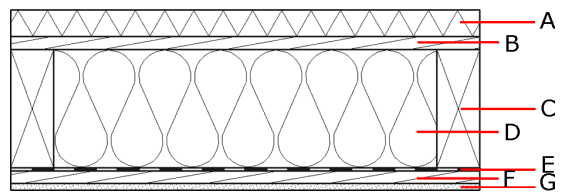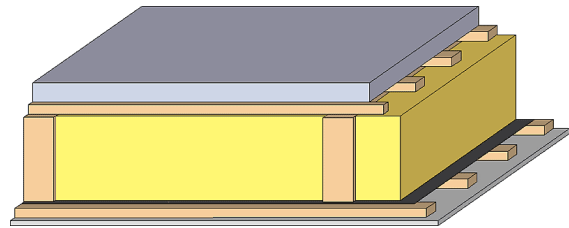

Note: e=625

**Register of building materials used for this application, cross-section** (from outside to inside, dimensions in mm)

	Thickness	Building material	Thermal performance				Reaction to fire EN
			$\lambda$	$\mu$ min – max	$\rho$	c	
A	50.0	Magnesite-bound lightweight wood wool board	0.120	2 - 5	700	1.400	
B	24.0	spruce wood cladding with spacing of cladding boards(24/100); a=400	0.120	50	450	1.600	D
C	220.0	construction timber (80/...; e=*)	0.120	50	450	1.600	D
D	220.0	mineral wool [040; $\geq 16$ ; $< 1000^\circ\text{C}$ ]	0.040	1	16	1.030	A1
E		vapour barrier $s_d \geq 2\text{m}$			1000		
F	24.0	spruce wood cladding with spacing of cladding boards(24/100); a=400	0.120	50	450	1.600	D
G	12.5	gypsum plaster board type DF or	0.250	10	800	1.050	A2
G	12.5	gypsum fibre board	0.320	21	1000	1.100	A2

**Sustainability rating** (per  $\text{m}^2$ )

Database ecoinvent

$OI3_{Kon}$  22.3

Calculated by HFA

**Details of sustainability rating**

Database ecoinvent

Lifecycle (Phases)	GWP [kg CO <sub>2</sub> -e.]	AP [kg SO <sub>2</sub> -e.]	EP [kg PO <sub>4</sub> -e.]	ODP [kg R11-e.]	POCP [kg Ethen-e.]	
A1 - A3	-20.181	0.102	0.043	2,08E-6	0.007	

Lifecycle (Phases)	PERE [MJ]	PERM [MJ]	PERT [MJ]	PENRE [MJ]	PENRM [MJ]	PENRT [MJ]
A1 - A3	34.264	455.301	489.565	341.810	20.201	362.011