

External wall - awrohi01b-05

external wall, timber frame construction, not ventilated, with dry lining, with cladding, other surface

Performance rating

| | | |
|-----------------------------|------------------|----|
| Fire protection performance | REI from inside | 60 |
| | REI from outside | 30 |

maximum ceiling height = 3 m; maximum load $E_{d,fi}$ = 19,2 kN/m
 Classified by HFA

| | | |
|---------------------|-----------|---------------------------|
| Thermal performance | U | 0.13 W/(m ² K) |
| | Diffusion | suitable |


Calculated by HFA

| | | |
|----------------------|-----------------------------|--------------|
| Acoustic performance | R_w (C;C _{tr}) | 55(-2;-8) dB |
| | $L_{n,w}$ (C _i) | |

battens for the dry lining mounted offset without using resilient clips will result in $R_w(C;C_{tr})=52(-2;-6)$ dB
 Assessed by MA39

| | | |
|--------------------|---|-------------------------|
| Mass per unit area | m | 81.10 kg/m ² |
|--------------------|---|-------------------------|

Calculation based on GF

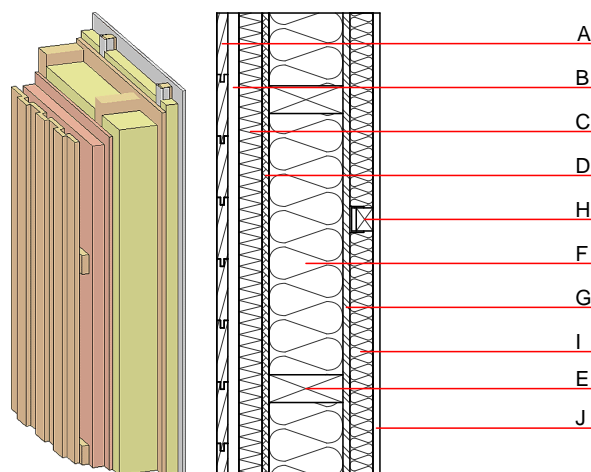

Note: e=625

Register of building materials used for this application, cross-section (from outside to inside, dimensions in mm)

| | Thickness | Building material | Thermal performance | | | | Reaction to fire EN |
|---|-----------|---|---------------------|-----------------|--------|-------|------------------------|
| | | | λ | μ min – max | ρ | c | |
| A | 24.0 | larch wood external wall cladding | 0.155 | 150 | 600 | 1.600 | D |
| B | 24.0 | spruce wood cross battens | 0.120 | 50 | 450 | 1.600 | D |
| C | 50.0 | wood wool composite boards | 0.090 | 2 - 5 | 370 | 2.000 | B |
| D | 15.0 | fibreboard (MDF) | 0.140 | 11 | 600 | 1.700 | D |
| E | 200.0 | construction timber (60/...; e=*) | 0.120 | 50 | 450 | 1.600 | D |
| F | 200.0 | mineral wool [040; ≥ 16 ; <1000°C] | 0.040 | 1 | 16 | 1.030 | A1 |
| G | 15.0 | OSB (sealed with airtight tape) | 0.130 | 200 | 600 | 1.700 | D |
| H | 80.0 | spruce wood battens offset mounted on resilient clips | 0.120 | 50 | 450 | 1.600 | D |
| I | 80.0 | mineral wool [040; ≥ 16 ; <1000°C] or air layer in type 02 | 0.040 | 1 | 16 | 1.030 | A1 |
| J | 15.0 | gypsum fibre board or | 0.320 | 21 | 1000 | 1.100 | A2 |
| J | 15.0 | gypsum plaster board type DF | 0.250 | 10 | 800 | 1.050 | A2 |

Sustainability rating (per m²)

Database ecoinvent

| | |
|--------------------|------|
| 013 _{Kon} | 33.2 |
|--------------------|------|

Calculated by HFA

Details of sustainability rating

Database ecoinvent

| Lifecycle (Phases) | GWP [kg CO ₂ -e.] | AP [kg SO ₂ -e.] | EP [kg PO ₄ -e.] | ODP [kg R11-e.] | POCP [kg Ethen-e.] | |
|-----------------------|---------------------------------|--------------------------------|--------------------------------|--------------------|-----------------------|---------------|
| A1 - A3 | | 0.164 | 0.071 | 2,94E-6 | 0.031 | |
| Lifecycle (Phases) | PERE [MJ] | PERM [MJ] | PERT [MJ] | PENRE [MJ] | PENRM [MJ] | PENRT [MJ] |
| A1 - A3 | 146.593 | 869.854 | 1016.447 | 557.803 | 28.891 | 586.695 |