

### External wall - awroho03a-07

external wall, timber frame construction, not ventilated, without dry lining, with cladding, other surface

#### Performance rating

**Fire protection performance** REI from inside 60  
 REI from outside 30  
 maximum ceiling height = 3 m; maximum load  $E_{d,fi} = 32,0 \text{ kN/m}$   
 Classified by HFA


**Thermal performance** U 0.23  $\text{W}/(\text{m}^2\text{K})$   
 Diffusion suitable  
 Calculated by HFA

**Acoustic performance**  $R_w (C;C_{tr})$  50(-2;-7) dB  
 $L_{n,w} (C_i)$

Vertical external battens screwed onto the ledger beams lead to an  $R_w(C;C_{tr})=46(-1;-5) \text{ dB}$   
 Assessed by MA39

**Mass per unit area** m 66.60  $\text{kg}/\text{m}^2$

Calculation based on GF

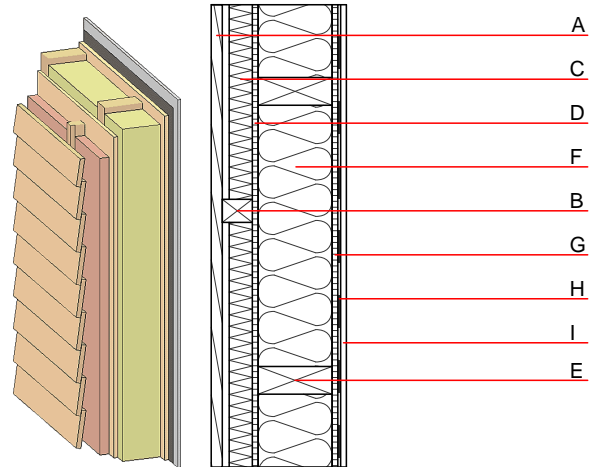

Note: e=625

#### Register of building materials used for this application, cross-section (from outside to inside, dimensions in mm)

	Thickness	Building material	Thermal performance				Reaction to fire EN
			$\lambda$	$\mu$ min - max	$\rho$	c	
A	24.0	larch wood external wall cladding	0.155	150	600	1.600	D
B	65.0	spruce wood cross battens	0.120	50	450	1.600	D
C	50.0	wood wool composite boards	0.090	2 - 5	370	2.000	B
D	16.0	particleboard	0.130	50 - 100	700	1.700	D
E	160.0	construction timber (60/..; e=*)	0.120	50	450	1.600	D
F	160.0	sheep wool [0,041; R=26]	0.041	1	30	1.720	E
G	12.0	particleboard	0.130	50 - 100	700	1.700	D
H		vapour barrier $s_d \geq 10\text{m}$			1000		
I	12.5	gypsum fibre board or	0.320	21	1000	1.100	A2
I'	12.5	gypsum plaster board type DF	0.250	10	800	1.050	A2

#### Sustainability rating (per $\text{m}^2$ )

##### Database ecoinvent

$OI3_{Kon}$  20.6

Calculated by HFA

**Details of sustainability rating**

Database ecoinvent

Lifecycle (Phases)	GWP [kg CO <sub>2</sub> -e.]	AP [kg SO <sub>2</sub> -e.]	EP [kg PO <sub>4</sub> -e.]	ODP [kg R11-e.]	POCP [kg Ethen-e.]	
A1 - A3		0.095	0.040	2,07E-6	0.027	

Lifecycle (Phases)	PERE [MJ]	PERM [MJ]	PERT [MJ]	PENRE [MJ]	PENRM [MJ]	PENRT [MJ]
A1 - A3	90.487	818.388	908.875	429.248	42.230	471.478