
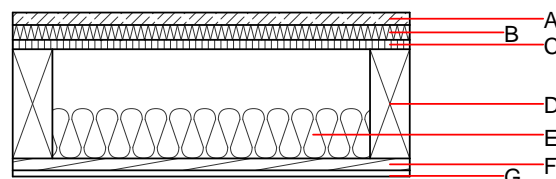


### Intermediate floor - gdrtn03a-09

intermediate floor, timber frame construction, not suspended, dry, without filling, other surface

#### Performance rating

<b>Fire protection performance</b>	REI	30
maximum span = 5 m; maximum load $E_{d,fi} = 3,66 \text{ kN/m}^2$ Classified by HFA		
<b>Thermal performance</b>	U Diffusion	0.27 $\text{W}/(\text{m}^2\text{K})$ suitable
Calculated by HFA		
<b>Acoustic performance</b>	$R_w (C;C_{tr})$ $L_{n,w} (C_i)$	49(-4;-11) dB 71(1)
EPS-F with a dynamic stiffness of $s' \leq 40\text{MN}/\text{m}^3$ . Assessed by TGM		
<b>Mass per unit area</b>	m	62.30 $\text{kg}/\text{m}^2$
Calculation based on GF		

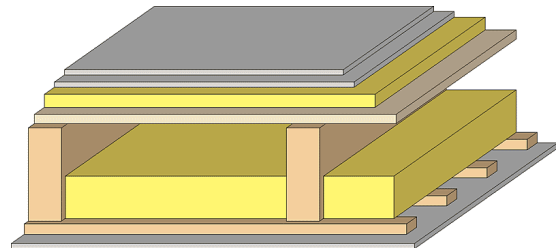

Note: e=625;

#### Register of building materials used for this application, cross-section (from outside to inside, dimensions in mm)

	Thickness	Building material	Thermal performance				Reaction to fire EN
			$\lambda$	$\mu$ min – max	$\rho$	c	
A	25.0	dry screed	0.210	8	900	1.050	A1
B	30.0	Polystyrene EPS-W [0,041]	0.041	20 - 50	15	1.450	E
C	19.0	particleboard	0.130	50 - 100	700	1.700	D
D	220.0	construction timber (80/...; e=*)	0.120	50	450	1.600	D
E	100.0	mineral wool [040; $\geq 16$ ; $< 1000^\circ\text{C}$ ]	0.040	1	16	1.030	A1
F	24.0	spruce wood cladding with spacing of cladding boards(24/100); a=400	0.120	50	450	1.600	D
G	12.5	gypsum plaster board type DF or	0.250	10	800	1.050	A2
G	12.5	gypsum fibre board	0.320	21	1000	1.100	A2

#### Sustainability rating (per $\text{m}^2$ )

##### Database ecoinvent

$OI3_{Kon}$  21.8

Calculated by HFA

### Details of sustainability rating

#### Database ecoinvent

Lifecycle (Phases)	GWP [kg CO <sub>2</sub> -e.]	AP [kg SO <sub>2</sub> -e.]	EP [kg PO <sub>4</sub> -e.]	ODP [kg R11-e.]	POCP [kg Ethen-e.]	
A1 - A3		0.087	0.037	1,85E-6	0.023	

Lifecycle (Phases)	PERE [MJ]	PERM [MJ]	PERT [MJ]	PENRE [MJ]	PENRM [MJ]	PENRT [MJ]
A1 - A3	64.396	473.735	538.132	385.078	45.415	430.493